



Accredited for compliance with ISO/IEC 17025 – Testing
NATA is a signatory to the ILAC Mutual Recognition Arrangement for the mutual recognition of the equivalence of testing, medical testing, calibration and inspection reports

OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

CG Street Skin 550MIC Outdoor Floor Lam applied to MDF board 1270mm x 30m

Prepared for: Creative Graphic Supplies Pty Ltd
Sarah Walters
Unit 22, 1029 Manly Road
TINGALPA QLD 4173

Sample Description: CG Street Skin 550MIC Outdoor Floor Lam applied to MDF board 1270mm x 30m

No. of Specimens & Size Supplied: 1 off, 612x1212 mm, (Sampling Conducted by Client)

Surface Structure: Structured

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Fixed

Test Direction: Test direction not applicable.

Joint Type & Width: N/A

Air Temperature: 22°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR 44-48 Rocco Drive, Scoresby, VIC, 3179

Test Date: 23 September 2026

Test Personnel: Sebastian Podsiadly Soto and Louie Karkatzoulis

Displacement Space (rounded to the nearest 0.5cm ³ /dm ²):	Not tested
Displacement Space Assessment Group (Appendix E, AS 4586 - 2013):	Not tested
Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree):	41°
Classification:	R13

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Prepared By:



Sebastian Podsiadly Soto
Compliance and Testing Technician

Reviewed By:



Dale Siegle
Technical Consultant - Compliance Services
Approved Signatory

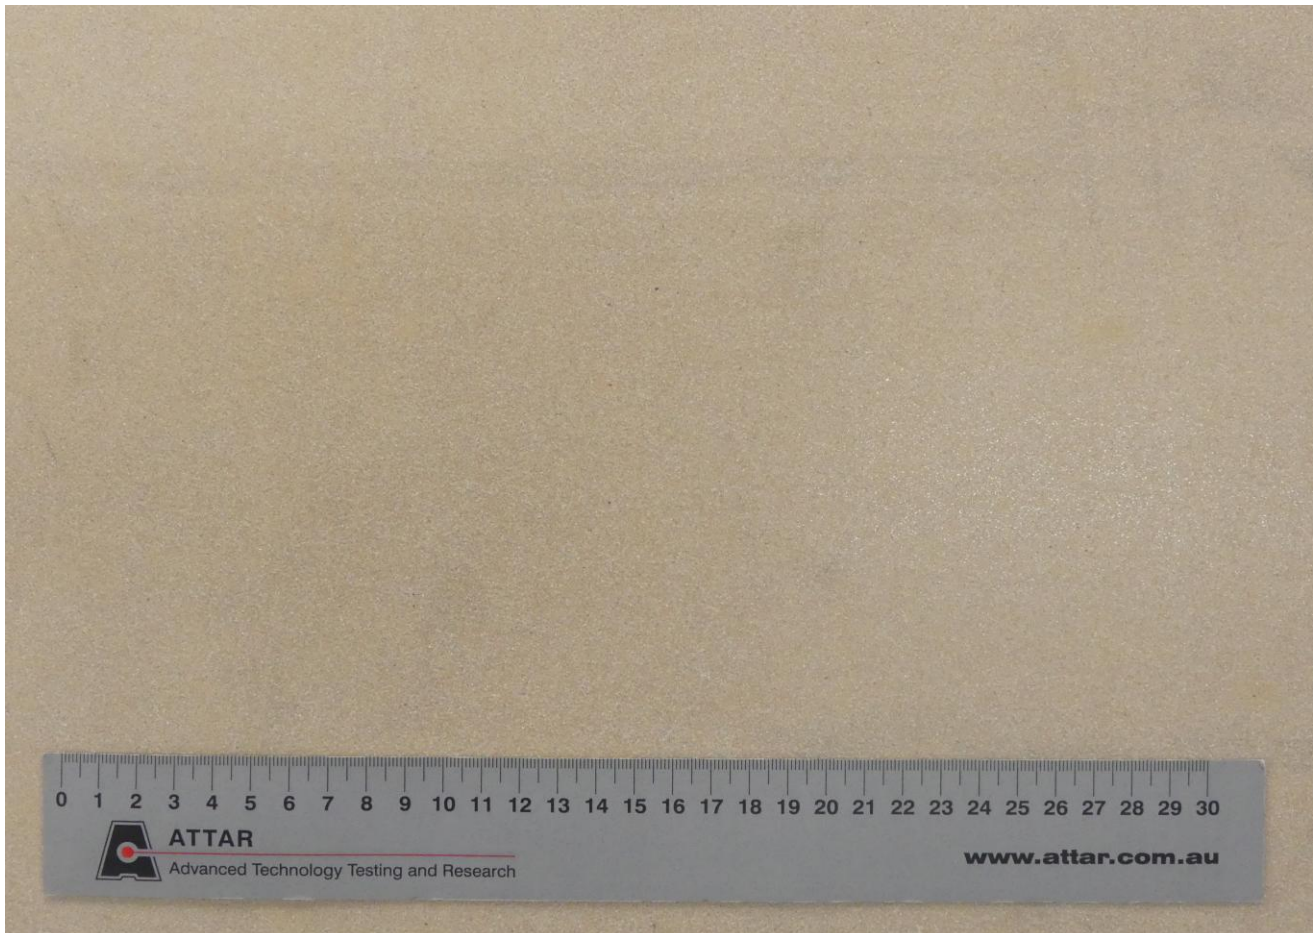


Figure 1: CG Street Skin 550MIC Outdoor Floor Lam applied to MDF board 1270mm x 30m



CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

**TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE
OIL-WET INCLINING PLATFORM TEST**

Classification	Angle, degrees
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35